


AANSLITSCHAMA – ECW TOUCH CONTROL

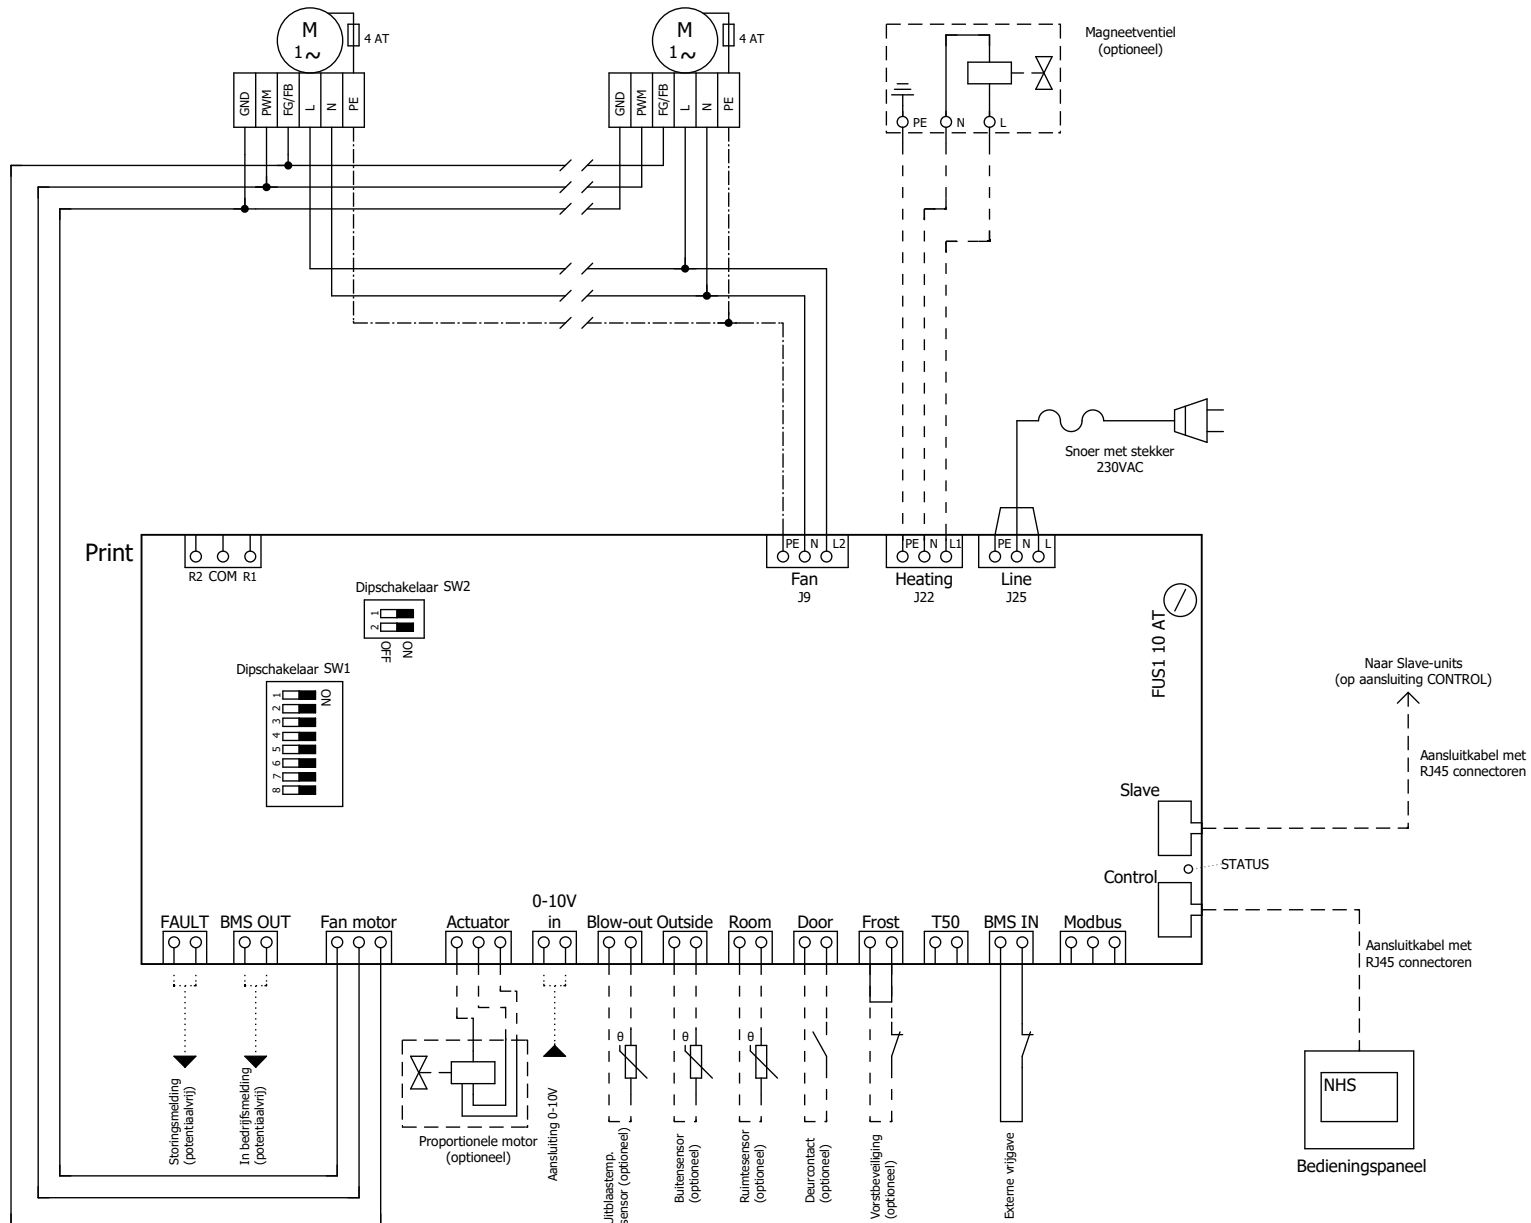

Instelling DIP-schakelaars

SW1

Master	SW1-1	OFF
Slave	SW1-2	ON

SW2

Standaard	SW2-1	ON	SW2-2	OFF
0-10V ingaand signaal	SW2-1	ON	SW2-2	ON

NHS Luchtgordijnen

Binnenweg 6, 5683 PR Best, **T** +31 (0)499 870 027, **F** +31 (0)499 870 028, **E** info@nhs.eu

www.nhs.eu